



Alaska Native Tribal Health Consortium

Division of Environmental Health and Engineering

3900 Ambassador Drive • Suite 301 • Anchorage, Alaska 99508 • Phone: (907) 729-3600 • Fax: (907) 729-4090 • www.anthc.org

April 16, 2013

The Honorable James Ayuluk
First Chief
City of Chevak
P O Box 136
Chevak, AK 99563

Dear First Chief Ayuluk

Re: Chevak Health Clinic

I have enclosed a copy of the report prepared as part of the energy **audit** of the Chevak Health Clinic. The audit was prepared by the Energy Projects Group of the Department of Environmental Health and Engineering (DEHE) at the Alaska Native Tribal Health Consortium (ANTHC). Please feel free to contact me at 907-729-3543 or cremley@anthc.org if you have any questions.

Once the energy efficiency measures are implemented, the fuel and electricity costs to operate the Chevak Health Clinic will be reduced by approximately \$4,249 per year or 29.9% of the \$14,172 annual energy cost in 2011.

The energy audit was performed with EECBG funds provided by Department of Energy grant DE-EE0001883. We encourage the City of Chevak to implement our recommendations. If funding the implementation is a concern, you might want to apply for the next round of EECBG funding.

Sincerely,

A handwritten signature in black ink, appearing to read "Carl H. Remley".

Carl H. Remley
Energy Projects Manager

Enclosure
Chevak Health Clinic Report

Cc: Ms. Olga Evan, YKHC w/enclosure
Ms. Deanna Latham, YKHC, w/enclosure
Mr. Greg McIntire, YKHC, w/enclosure
Ms. Susan Hoeldt YKHC w/enclosure



Comprehensive Energy Audit For Chevak Health Clinic



Prepared For
City of Chevak

March 30, 2013

Prepared By:

**ANHC-DEHE
3900 Ambassador Drive, Suite 301
Anchorage, AK 99508**

Table of Contents

The Energy Projects Group gratefully acknowledges the assistance of Tribal Administrator Angelique Anderson and the clinic staff.

1. EXECUTIVE SUMMARY	2
1. EXECUTIVE SUMMARY	3
2. AUDIT AND ANALYSIS BACKGROUND	4
2.1 Program Description	4
2.2 Audit Description	5
2.3. Method of Analysis	5
2.4 Limitations of Study	7
3. Health Clinic	7
3.1. Building Description	7
3.2 Predicted Energy Use	8
3.2.1 Energy Usage / Tariffs	8
3.2.2 Energy Use Index (EUI)	11
3.3 AkWarm© Building Simulation	12
4. ENERGY COST SAVING MEASURES.....	13
4.1 Summary of Results	13
4.2 Interactive Effects of Projects	13
Appendix A – Listing of Energy Conservation and Renewable Energy Websites.....	15

PREFACE

The Energy Projects Group at the Alaska Native Tribal Health Consortium (ANTHC) prepared this document for the Chevak Native Village. The authors of this report are Carl H. Remley, Certified Energy Auditor (CEA) and Certified Energy Manager (CEM) and Gavin Dixon.

The purpose of this report is to provide a comprehensive document that summarizes the findings and analysis that resulted from an energy audit conducted over the past couple months by the Energy Projects Group of ANTHC. This report analyzes historical energy use and identifies costs and savings of recommended energy efficiency measures. Discussions of site specific concerns and an Energy Efficiency Action Plan are also included in this report.

ACKNOWLEDGMENTS

The Energy Projects Group gratefully acknowledges the assistance of Tribal Administrator Angelique Anderson and the clinic staff.

1. EXECUTIVE SUMMARY

This report was prepared for the YKHC. The scope of the audit focused on Health Clinic. The scope of this report is a comprehensive energy study, which included an analysis of building shell, interior and exterior lighting systems, HVAC systems, and plug loads.

Based on electricity and fuel oil prices in effect at the time of the audit, the annual predicted energy costs for the buildings analyzed are \$5,792 for Electricity and \$8,380 for #1 Oil, with total energy costs of \$14,172 per year.

It should be noted that this facility received the power cost equalization (PCE) subsidy from the state of Alaska last year. If this facility had not received PCE, total electrical costs would have been \$15,204.

Table 1.1 below summarizes the energy efficiency measures analyzed for the Health Clinic. Listed are the estimates of the annual savings, installed costs, and two different financial measures of investment return.

Table 1.1 PRIORITY LIST – ENERGY EFFICIENCY MEASURES						
Rank	Feature	Improvement Description	Annual Energy Savings	Installed Cost	Savings to Investment Ratio, SIR ¹	Simple Payback (Years) ²
1	Setback Thermostat: Health Clinic	Implement a Heating Temperature Unoccupied Setback to 60.0 deg F for the Health Clinic space.	\$1,519	\$1,000	20.60	0.7
2	HVAC And DHW	The air control dampers in the utilidor beneath the building are leading to poor distribution of air, and increase the chance that the sewer line and tank will freeze. The dampers need to be repaired and the insulation reworked so it does not block the airflow. Also, the utilidor plywood cover needs to be properly installed and sealed to prevent cold air leakage into the utilidor.	\$777	\$3,000	3.20	3.9
3	Other Electrical - Controls Retrofit: Utilidor Heat Tape	Remove Manual Switching and Add new Other Controls	\$945	\$2,000	2.93	2.1
4	Air Tightening	Perform air sealing to reduce air leakage by 1750 cfm at 50 Pascals.	\$1,953	\$7,500	2.41	3.8
	TOTAL, all measures		\$5,194	\$13,500	4.01	2.6

Table Notes:

¹ Savings to Investment Ratio (SIR) is a life-cycle cost measure calculated by dividing the total savings over the life of a project (expressed in today's dollars) by its investment costs. The SIR is an indication of the profitability of a measure; the higher the SIR, the more profitable the project. An SIR greater than 1.0 indicates a cost-effective project (i.e. more savings than cost). Remember that this profitability is based on the position of that Energy Efficiency Measure (EEM) in the overall list and assumes that the measures above it are implemented first.

² Simple Payback (SP) is a measure of the length of time required for the savings from an EEM to payback the investment cost, not counting interest on the investment and any future changes in energy prices. It is calculated by dividing the investment cost by the expected first-year savings of the EEM.

With all of these energy efficiency measures in place, the annual utility cost can be reduced by \$5,194 per year, or 36.7% of the buildings' total energy costs. These measures are estimated to cost \$13,500, for an overall simple payback period of 2.6 years.

Table 1.2 below is a breakdown of the annual energy cost across various energy end use types, such as Space Heating and Water Heating. The first row in the table shows the breakdown for the building as it is now. The second row shows the expected breakdown of energy cost for the building assuming all of the retrofits in this report are implemented. Finally, the last row shows the annual energy savings that will be achieved from the retrofits.

Table 1.2 Annual Energy Cost Estimate										
Description	Space Heating	Space Cooling	Water Heating	Lighting	Refrigeration	Other Electrical	Cooking	Clothes Drying	Ventilation Fans	Total Cost
Existing Building	\$9,464	\$0	\$658	\$945	\$184	\$2,892	\$30	\$0	\$0	\$14,172
With All Proposed Retrofits	\$5,222	\$0	\$651	\$945	\$184	\$1,946	\$30	\$0	\$0	\$8,977
SAVINGS	\$4,242	\$0	\$7	\$0	\$0	\$945	\$0	\$0	\$0	\$5,194

2. AUDIT AND ANALYSIS BACKGROUND

2.1 Program Description

This audit included services to identify, develop, and evaluate energy efficiency measures at the Health Clinic. The scope of this project included evaluating building shell, lighting and other electrical systems, and HVAC equipment, motors and pumps. Measures were analyzed based on life-cycle-cost techniques, which include the initial cost of the equipment, life of the equipment, annual energy cost, annual maintenance cost, and a discount rate of 3.0%/year in excess of general inflation.

2.2 Audit Description

Preliminary audit information was gathered in preparation for the site survey. The site survey provides critical information in deciphering where energy is used and what opportunities exist within a building. The entire site was surveyed to inventory the following to gain an understanding of how each building operates:

- Building envelope (roof, windows, etc.)
- Heating, ventilation, and air conditioning equipment (HVAC)
- Lighting systems and controls
- Building-specific equipment
- Water consumption, treatment (optional) & disposal

The building site visit was performed to survey all major building components and systems. The site visit included detailed inspection of energy consuming components. Summary of building occupancy schedules, operating and maintenance practices, and energy management programs provided by the building manager were collected along with the system and components to determine a more accurate impact on energy consumption.

Details collected from Health Clinic enable a model of the building's energy usage to be developed, highlighting the building's total energy consumption, energy consumption by specific building component, and equivalent energy cost. The analysis involves distinguishing the different fuels used on site, and analyzing their consumption in different activity areas of the building.

Health Clinic is classified as being made up of the following activity areas:

- 1) Health Clinic: 2,400 square feet

In addition, the methodology involves taking into account a wide range of factors specific to the building. These factors are used in the construction of the model of energy used. The factors include:

- Occupancy hours
- Local climate conditions
- Prices paid for energy

2.3. Method of Analysis

Data collected was processed using AkWarm© Energy Use Software to estimate energy savings for each of the proposed energy efficiency measures (EEMs). The recommendations focus on the building envelope; HVAC; lighting, plug load, and other electrical improvements; and motor and pump systems that will reduce annual energy consumption.

EEMs are evaluated based on building use and processes, local climate conditions, building construction type, function, operational schedule, existing conditions, and foreseen future plans. Energy savings are calculated based on industry standard methods and engineering estimations.

Our analysis provides a number of tools for assessing the cost effectiveness of various improvement options. These tools utilize **Life-Cycle Costing**, which is defined in this context as a method of cost analysis that estimates the total cost of a project over the period of time that includes both the construction cost and ongoing maintenance and operating costs.

Savings to Investment Ratio (SIR) = Savings divided by Investment

Savings includes the total discounted dollar savings considered over the life of the improvement. When these savings are added up, changes in future fuel prices as projected by the Department of Energy are included. Future savings are discounted to the present to account for the time-value of money (i.e. money's ability to earn interest over time). The **Investment** in the SIR calculation includes the labor and materials required to install the measure. An SIR value of at least 1.0 indicates that the project is cost-effective—total savings exceed the investment costs.

Simple payback is a cost analysis method whereby the investment cost of a project is divided by the first year's savings of the project to give the number of years required to recover the cost of the investment. This may be compared to the expected time before replacement of the system or component will be required. For example, if a boiler costs \$12,000 and results in a savings of \$1,000 in the first year, the payback time is 12 years. If the boiler has an expected life to replacement of 10 years, it would not be financially viable to make the investment since the payback period of 12 years is greater than the project life.

The Simple Payback calculation does not consider likely increases in future annual savings due to energy price increases. As an offsetting simplification, simple payback does not consider the need to earn interest on the investment (i.e. it does not consider the time-value of money). Because of these simplifications, the SIR figure is considered to be a better financial investment indicator than the Simple Payback measure.

Measures are implemented in order of cost-effectiveness. The program first calculates individual SIRs, and ranks all measures by SIR, higher SIRs at the top of the list. An individual measure must have an individual $SIR \geq 1$ to make the cut. Next the building is modified and re-simulated with the highest ranked measure included. Now all remaining measures are re-evaluated and ranked, and the next most cost-effective measure is implemented. AkWarm goes through this iterative process until all appropriate measures have been evaluated and installed.

It is important to note that the savings for each recommendation is calculated based on implementing the most cost effective measure first, and then cycling through the list to find the next most cost effective measure. Implementation of more than one EEM often affects the savings of other EEMs. The savings may in some cases be relatively higher if an individual EEM is implemented in lieu of multiple recommended EEMs. For example implementing a reduced operating schedule for inefficient lighting will result in relatively high savings. Implementing a reduced operating schedule for newly installed efficient lighting will result in lower relative savings, because the efficient lighting system uses less energy during each hour of operation. If

multiple EEM's are recommended to be implemented, AkWarm calculates the combined savings appropriately.

Cost savings are calculated based on estimated initial costs for each measure. Installation costs include labor and equipment to estimate the full up-front investment required to implement a change. Costs are derived from Means Cost Data, industry publications, and local contractors and equipment suppliers.

2.4 Limitations of Study

All results are dependent on the quality of input data provided, and can only act as an approximation. In some instances, several methods may achieve the identified savings. This report is not intended as a final design document. The design professional or other persons following the recommendations shall accept responsibility and liability for the results.

3. Health Clinic

3.1. Building Description

The 2,400 square foot Health Clinic was constructed in 1985, with a normal occupancy of 5 people. The number of hours of operation for this building average eight hours per day, Monday through Friday.

Building Shell

The exterior walls are double 2x6 walls with 5.5 inches of R-19 fiberglass batt insulation.

The roof of the building is a cold roof with 14 inches of fiberglass batt insulation.

The floor of the building is built on pilings with eight inches of fiberglass batt insulation.

Typical windows throughout the building are double paned windows with vinyl frames.

Doors are metal with a polyurethane core.

Description of Heating Plants

The Heating Plants used in the building are:

Lennox Elite Series

Fuel Type:	#1 Oil
Input Rating:	113,900 BTU/hr
Steady State Efficiency:	76 %
Idle Loss:	1 %
Heat Distribution Type:	Air

Rheem Oil Fired Hot Water Heater

Fuel Type:	#1 Oil
------------	--------

Input Rating:	87,100 BTU/hr
Steady State Efficiency:	77 %
Idle Loss:	1.5 %
Heat Distribution Type:	Water
Boiler Operation:	All Year

Space Heating Distribution Systems

Heat is distributed throughout the facility with a forced air furnace through in ceiling ducted ventilation.

Domestic Hot Water System

An oil fired Rheem 25 gallon hot water heater with R-10 insulation supplies the building with about 20 gallons of hot water per day.

Lighting

Lighting in the facility consists of fluorescent T8 electronic ballast lighting with 32 watt bulbs. Exterior lighting consists of Metal Halide fixtures.

Plug Loads

Plug loads in the facility are made up primarily of computers, medical equipment, and two refrigerators, a printer, a bank of telecomm equipment and various appliances.

Major Equipment

A small circulation pump for the water service, and a heat tape for the utilidor are the only major equipment in the facility.

3.2 Predicted Energy Use

3.2.1 Energy Usage / Tariffs

The electric usage profile charts (below) represents the predicted electrical usage for the building. If actual electricity usage records were available, the model used to predict usage was calibrated to approximately match actual usage. The electric utility measures consumption in kilowatt-hours (kWh) and maximum demand in kilowatts (kW). One kWh usage is equivalent to 1,000 watts running for one hour.

The fuel oil usage profile shows the fuel oil usage for the building. Fuel oil consumption is measured in gallons. One gallon of #1 Fuel Oil provides approximately 132,000 BTUs of energy.

The following is a list of the utility companies providing energy to the building and the class of service provided:

Electricity: AVEC-Chevak - Commercial - Sm

The average cost for each type of fuel used in this building is shown below in Table 3.1. This figure includes all surcharges, subsidies, and utility customer charges:

Table 3.1 – Average Energy Cost	
Description	Average Energy Cost
Electricity	\$ 0.16/kWh
#1 Oil	\$ 4.27/gallons

3.2.1.1 Total Energy Use and Cost Breakdown

At current rates, YKHC pays approximately \$14,172 annually for electricity and other fuel costs for the Health Clinic.

Figure 3.1 below reflects the estimated distribution of costs across the primary end uses of energy based on the AkWarm© computer simulation. Comparing the “Retrofit” bar in the figure to the “Existing” bar shows the potential savings from implementing all of the energy efficiency measures shown in this report.

Figure 3.1
Annual Energy Costs by End Use

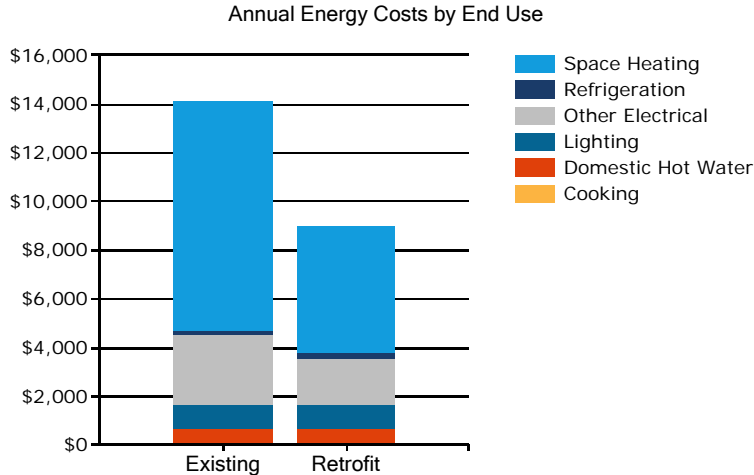


Figure 3.2 below shows how the annual energy cost of the building splits between the different fuels used by the building. The “Existing” bar shows the breakdown for the building as it is now; the “Retrofit” bar shows the predicted costs if all of the energy efficiency measures in this report are implemented.

Figure 3.2
Annual Energy Costs by Fuel Type


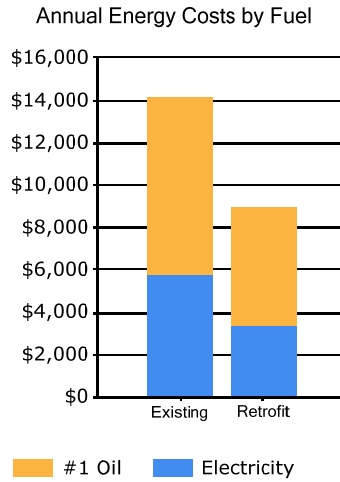


Figure 3.3 below addresses only Space Heating costs. The figure shows how each heat loss component contributes to those costs; for example, the figure shows how much annual space heating cost is caused by the heat loss through the Walls/Doors. For each component, the space heating cost for the Existing building is shown (blue bar) and the space heating cost assuming all retrofits are implemented (yellow bar) are shown.

Figure 3.3
Annual Space Heating Cost by Component

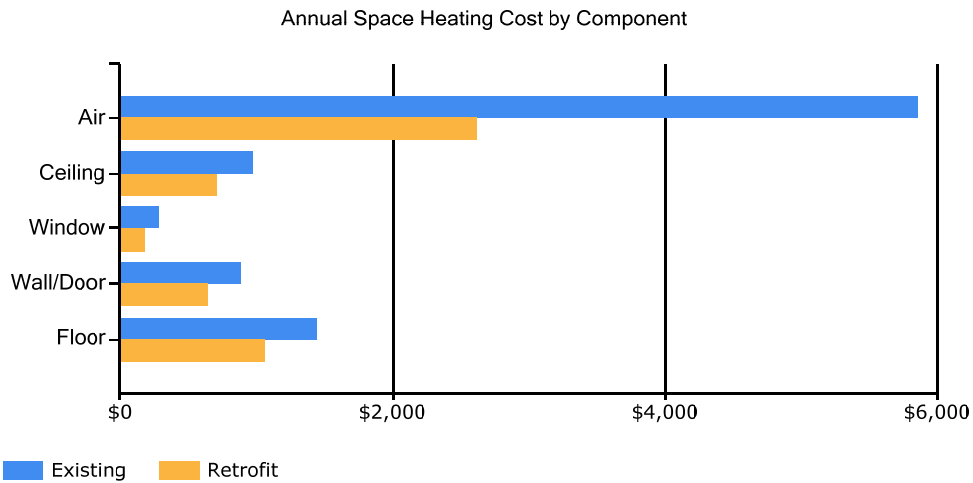

The tables below show AkWarm’s estimate of the monthly fuel use for each of the fuels used in the building. For each fuel, the fuel use is broken down across the energy end uses. Note, in the tables below “DHW” refers to Domestic Hot Water heating.

Electrical Consumption (kWh)												
	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sept	Oct	Nov	Dec
Lighting	501	457	501	485	501	485	501	501	485	501	485	501
Refrigeration	98	89	98	94	98	94	98	98	94	98	94	98
Other_Electrical	1534	1398	1534	1484	1534	1484	1534	1534	1484	1534	1484	1534
Cooking	16	14	16	15	16	15	16	16	15	16	15	16
Ventilation_Fans	0	0	0	0	0	0	0	0	0	0	0	0
DHW	8	7	8	8	8	8	8	8	8	8	8	8
Space_Heating	932	850	927	888	906	872	900	900	875	914	893	932

Fuel Oil #1 Consumption (Gallons)												
	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sept	Oct	Nov	Dec
DHW	13	12	13	12	13	12	13	13	12	13	12	13
Space_Heating	311	283	261	164	64	13	6	8	42	136	213	311

3.2.2 Energy Use Index (EUI)

Energy Use Index (EUI) is a measure of a building's annual energy utilization per square foot of building. This calculation is completed by converting all utility usage consumed by a building for one year, to British Thermal Units (Btu) or kBtu, and dividing this number by the building square footage. EUI is a good measure of a building's energy use and is utilized regularly for comparison of energy performance for similar building types. The Oak Ridge National Laboratory (ORNL) Buildings Technology Center under a contract with the U.S. Department of Energy maintains a Benchmarking Building Energy Performance Program. The ORNL website determines how a building's energy use compares with similar facilities throughout the U.S. and in a specific region or state.

Source use differs from site usage when comparing a building's energy consumption with the national average. Site energy use is the energy consumed by the building at the building site only. Source energy use includes the site energy use as well as all of the losses to create and distribute the energy to the building. Source energy represents the total amount of raw fuel that is required to operate the building. It incorporates all transmission, delivery, and production losses, which allows for a complete assessment of energy efficiency in a building. The type of utility purchased has a substantial impact on the source energy use of a building. The EPA has determined that source energy is the most comparable unit for evaluation purposes and overall global impact. Both the site and source EUI ratings for the building are provided to understand and compare the differences in energy use.

The site and source EUIs for this building are calculated as follows. (See Table 3.4 for details):

$$\text{Building Site EUI} = \frac{(\text{Electric Usage in kBtu} + \text{Fuel Oil Usage in kBtu})}{\text{Building Square Footage}}$$

$$\text{Building Source EUI} = \frac{(\text{Electric Usage in kBtu} \times \text{SS Ratio} + \text{Fuel Oil Usage in kBtu} \times \text{SS Ratio})}{\text{Building Square Footage}}$$

where "SS Ratio" is the Source Energy to Site Energy ratio for the particular fuel.

**Table 3.4
Health Clinic EUI Calculations**

Energy Type	Building Fuel Use per Year	Site Energy Use per Year, kBTU	Source/Site Ratio	Source Energy Use per Year, kBTU
Electricity	36,202 kWh	123,557	3.340	412,679
#1 Oil	1,962 gallons	259,042	1.010	261,632
Total		382,599		674,312
BUILDING AREA 2,400 Square Feet				
BUILDING SITE EUI 159 kBTU/Ft ² /Yr				
BUILDING SOURCE EUI 281 kBTU/Ft ² /Yr				
* Site - Source Ratio data is provided by the Energy Star Performance Rating Methodology for Incorporating Source Energy Use document issued March 2011.				

3.3 AkWarm© Building Simulation

An accurate model of the building performance can be created by simulating the thermal performance of the walls, roof, windows and floors of the building. The HVAC system and central plant are modeled as well, accounting for the outside air ventilation required by the building and the heat recovery equipment in place.

The model uses local weather data and is trued up to historical energy use to ensure its accuracy. The model can be used now and in the future to measure the utility bill impact of all types of energy projects, including improving building insulation, modifying glazing, changing air handler schedules, increasing heat recovery, installing high efficiency boilers, using variable air volume air handlers, adjusting outside air ventilation and adding cogeneration systems.

For the purposes of this study, the Health Clinic was modeled using AkWarm© energy use software to establish a baseline space heating and cooling energy usage. Climate data from Chevak was used for analysis. From this, the model was calibrated to predict the impact of theoretical energy savings measures. Once annual energy savings from a particular measure were predicted and the initial capital cost was estimated, payback scenarios were approximated. Equipment cost estimate calculations are provided in Appendix D.

Limitations of AkWarm© Models

- The model is based on typical mean year weather data for Chevak. This data represents the average ambient weather profile as observed over approximately 30 years. As such, the gas and electric profiles generated will not likely compare perfectly with actual energy billing information from any single year. This is especially true for years with extreme warm or cold periods, or even years with unexpectedly moderate weather.
- The heating and cooling load model is a simple two-zone model consisting of the building's core interior spaces and the building's perimeter spaces. This simplified approach loses accuracy for buildings that have large variations in cooling/heating loads across different parts of the building.

- The model does not model HVAC systems that simultaneously provide both heating and cooling to the same building space (typically done as a means of providing temperature control in the space).

The energy balances shown in Section 3.1 were derived from the output generated by the AkWarm© simulations.

4. ENERGY COST SAVING MEASURES

4.1 Summary of Results

The energy saving measures are summarized in Table 4.1. Please refer to the individual measure descriptions later in this report for more detail. Calculations and cost estimates for analyzed measures are provided in Appendix C.

Table 4.1 Health Clinic, Chevak, Alaska PRIORITY LIST – ENERGY EFFICIENCY MEASURES						
Rank	Feature	Improvement Description	Annual Energy Savings	Installed Cost	Savings to Investment Ratio, SIR	Simple Payback (Years)
1	Setback Thermostat: Health Clinic	Implement a Heating Temperature Unoccupied Setback to 60.0 deg F for the Health Clinic space.	\$1,519	\$1,000	20.60	0.7
2	HVAC And DHW	The air control dampers in the utilidor beneath the building are leading to poor distribution of air, and increase the chance that the sewer line and tank will freeze. The dampers need to be repaired and the insulation reworked so it does not block the airflow. Also, the utilidor plywood cover needs to be properly installed and sealed to prevent cold air leakage into the utilidor.	\$777	\$3,000	3.20	3.9
3	Other Electrical - Controls Retrofit: Utilidor Heat Tape	Remove Manual Switching and Add new Other Controls	\$945	\$2,000	2.93	2.1
4	Air Tightening	Perform air sealing to reduce air leakage by 1750 cfm at 50 Pascals.	\$1,953	\$7,500	2.41	3.8
TOTAL, all measures			\$5,194	\$13,500	4.01	2.6

4.2 Interactive Effects of Projects

The savings for a particular measure are calculated assuming all recommended EEMs coming before that measure in the list are implemented. If some EEMs are not implemented, savings for the remaining

EEMs will be affected. For example, if ceiling insulation is not added, then savings from a project to replace the heating system will be increased, because the heating system for the building supplies a larger load.

In general, all projects are evaluated sequentially so energy savings associated with one EEM would not also be attributed to another EEM. By modeling the recommended project sequentially, the analysis accounts for interactive affects among the EEMs and does not “double count” savings.

Interior lighting, plug loads, facility equipment, and occupants generate heat within the building. When the building is in cooling mode, these items contribute to the overall cooling demands of the building; therefore, lighting efficiency improvements will reduce cooling requirements in air-conditioned buildings. Conversely, lighting-efficiency improvements are anticipated to slightly increase heating requirements. Heating penalties and cooling benefits were included in the lighting project analysis.

4.3 Building Shell Measures

4.3.1 Air Sealing Measures

Rank	Location	Existing Air Leakage Level (cfm@50/75 Pa)	Recommended Air Leakage Reduction (cfm@50/75 Pa)
4		Air Tightness from Blower Door Test: 4700 cfm at 50 Pascals	Perform air sealing to reduce air leakage by 1750 cfm at 50 Pascals.
Installation Cost	\$7,500	Estimated Life of Measure (yrs)	10
Energy Savings (/yr)		Simple Payback yrs	4
Breakeven Cost	\$18,079	Savings-to-Investment Ratio	2.4
Auditors Notes: Significant leakage from the two outside fresh air ducts back through the return air plenum above the dropped ceiling into the building.			

4.4 Mechanical Equipment Measures

4.4.1 Heating/ Domestic Hot Water Measure

Rank	Recommendation
2	The air control dampers in the utilidor beneath the building are leading to poor distribution of air, and increase the chance that the sewer line and tank will freeze. The dampers need to be repaired and the insulation reworked so it does not block the airflow. Also, the utilidor plywood cover needs to be properly installed and sealed to prevent cold air leakage into the utilidor.
Installation Cost	\$3,000
Estimated Life of Measure (yrs)	20
Energy Savings (/yr)	\$777
Breakeven Cost	\$9,586
Savings-to-Investment Ratio	3.2
Simple Payback yrs	4
Auditors Notes: The utilidor needs to be rebuilt and re-commissioned.	

4.4.2 Night Setback Thermostat Measures

Rank	Building Space	Recommendation
1	Health Clinic	Implement a Heating Temperature Unoccupied Setback to 60.0 deg F for the Health Clinic space.
Installation Cost	\$1,000	Estimated Life of Measure (yrs)
		15
Energy Savings (/yr)		\$1,519
Breakeven Cost	\$20,601	Savings-to-Investment Ratio
		20.6
Simple Payback yrs		1
Auditors Notes: The heating system in the facility should be controlled by a simple setback thermostat, programmed to keep the building heated to only 60 degrees when the facility is unoccupied, such as at nights and on weekends.		

4.5 Electrical & Appliance Measures

4.5.1 Other Electrical Measures

Rank	Location	Description of Existing	Efficiency Recommendation
3	Utilidor Heat Tape	Electric Heat Tape with Manual Switching	Remove Manual Switching and Add new Other Controls
Installation Cost	\$2,000	Estimated Life of Measure (yrs)	7
Energy Savings (/yr)		Simple Payback yrs	2
Breakeven Cost	\$5,852	Savings-to-Investment Ratio	2.9
Auditors Notes: Firmly attach the electric heat tape to the sewer line and add a temperature controller with a probe in the utilidor that shuts off the heat tape when it is not required.			

5. ENERGY EFFICIENCY ACTION PLAN

Through inspection of the energy-using equipment on-site and discussions with site facilities personnel, this energy audit has identified several energy-saving measures. The measures will reduce the amount of fuel burned and electricity used at the site. The projects will not degrade the performance of the building and, in some cases, will improve it.

Several types of EEMs can be implemented immediately by building staff, and others will require various amounts of lead time for engineering and equipment acquisition. In some cases, there are logical advantages to implementing EEMs concurrently. For example, if the same electrical contractor is used to install both lighting equipment and motors, implementation of these measures should be scheduled to occur simultaneously.

Appendix A – Listing of Energy Conservation and Renewable Energy Websites

Lighting

Illumination Engineering Society - <http://www.iesna.org/>

Energy Star Compact Fluorescent Lighting Program - www.energystar.gov/index.cfm?c=cfls.pr_cfls

DOE Solid State Lighting Program - <http://www1.eere.energy.gov/buildings/ssl/>

DOE office of Energy Efficiency and Renewable Energy - http://apps1.eere.energy.gov/consumer/your_workplace/

Energy Star – http://www.energystar.gov/index.cfm?c=lighting.pr_lighting

Hot Water Heaters

Heat Pump Water Heaters -

http://apps1.eere.energy.gov/consumer/your_home/water_heating/index.cfm/mytopic=12840

Solar Water Heating

FEMP Federal Technology Alerts – http://www.eere.energy.gov/femp/pdfs/FTA_solwat_heat.pdf

Solar Radiation Data Manual – <http://rredc.nrel.gov/solar/pubs/redbook>

Plug Loads

DOE office of Energy Efficiency and Renewable Energy – http://apps1.eere.energy.gov/consumer/your_workplace/

Energy Star – http://www.energystar.gov/index.cfm?fuseaction=find_a_product

The Greenest Desktop Computers of 2008 - <http://www.metaefficient.com/computers/the-greenest-pcs-of-2008.html>

Wind

AWEA Web Site – <http://www.awea.org>

National Wind Coordinating Collaborative – <http://www.nationalwind.org>

Utility Wind Interest Group site: <http://www.uwig.org>

WPA Web Site – <http://www.windpoweringamerica.gov>

Homepower Web Site: <http://homepower.com>

Windustry Project: <http://www.windustry.com>

Solar

NREL – <http://www.nrel.gov/rredc/>

Firstlook – <http://firstlook.3tiergroup.com>

TMY or Weather Data – http://rredc.nrel.gov/solar/old_data/nsrdb/1991-2005/tmy3/

State and Utility Incentives and Utility Policies - <http://www.dsireusa.org>